Tripolitana Medical Journal; 2026, Vol. 15, No. 1, pp. 26 - 30

Research Article
ISSN 2077-5628

Evaluating Infection Prevention and Control (IPC) Response in Medical Laboratory Wastewater Management

Ahmed A Algdar[@1] and Mahfoud M. Alwalid[2]

[1]Department of Medical Laboratory. [2]Department of Public Health, Faculty of Health Science, Al Asmarya Islamic University, Zliten, Libya.

Received 10 March 2026/ Accepted 3rd April 2026; Published 16 April 2026

ABSTRACT

Assessment of Infection Prevention and Control (IPC) Response in the Management and Disinfection of Wastewater from Medical Laboratories. This study aimed to evaluate the extent to which medical laboratories adhere to infection prevention standards in handling liquid waste and to identify gaps between operational procedures and adopted policies. The study employed a descriptive-analytical approach, with a sample of 150 specialists (4 department heads, representing 2.7%, and 146 laboratory specialists, representing 97.3%). A validated questionnaire was used as the primary data collection instrument. The results revealed a sharp disparity in compliance levels; compliance with sewer network maintenance reached 100%, while compliance (0%) was nonexistent in the areas of chemical disinfection, the existence of written policies, water classification, and annual staff training. All participants (100%) agreed that the effectiveness of the current response is "very weak." The study recommends the development of mandatory policies for wastewater disinfection at the source, the implementation of specialized training programs, and the integration of network maintenance with biological and chemical treatment protocols to ensure a safe and hygienic environment

Keywords *– Infection; Sewage water; Medical laboratory; Environment; Management.*

INTRODUCTION

This is a comprehensive and well-structured overview of the critical challenges facing medical laboratory wastewater management, particularly in the context of Zliten. Your focus on the intersection of technical "Best Available Technology" (BAT) and local ethical responsibility is both timely and required.[1] Wastewater management in medical laboratories is a critical challenge for infection prevention. The problem lies in a significant gap between the structural maintenance of the networks and compliance with biological protocols, posing a threat to public health and the environment.[3]

Medical laboratory wastewater is significantly more complex than standard municipal sewage because it combines biological hazards with aggressive chemical profiles.

Biological Hazards: Pathogens, viral loads (HIV, Hepatitis), and multi-drug resistant organisms (MDROs).

Chemical Hazards: Formaldehyde, xylene, heavy metals (from certain reagents), and high/low pH solutions.

Pharmaceutical Hazards: Residual antibiotics and disinfectants that disrupt natural bacterial cycles.[4]

Infection Prevention and Control standards requires more than just pouring disinfectant down the drain.

Effective treatment typically involves a multi-stage approach:

1. *Neutralization*: Adjusting the pH of acidic or alkaline reagent waste.

2. *Disinfection*: Using validated methods like Ozonation, UV Irradiation, or Chemical Chlorination (ensuring correct contact time).

3. *Pre-treatment/Filtration*: Removing solid particulates before the liquid enters the municipal system. [5]

Infection Prevention response in the city, the following Vulnerability Gap must be investigated:

- *Infrastructure Age*: Are the existing pipes and holding tanks resistant to chemical corrosion?

- *Monitoring Protocols*: Is there a routine schedule for testing the effluent before it leaves the facility?

- *Training*: Do laboratory personnel understand the difference between disposal and treatment?.[6]

Ethical Note: failure to manage this waste is not just a technical error; it is a breach of the "Do No Harm" principle in healthcare, shifting the burden of disease from the patient to the community.

The Problem of the study:

1, Although international and national guidelines issued by the World Health Organization (WHO) and national

@Author to whom correspondence should be addressed: Dr. Ahmed AAlgdar, *Tel*: +218 91 1718502; e-mail: a.algedar@asmarya.edu.ly

control centers on infection prevention and control (IPC) and medical waste management exist, the focus is often on solid waste, while the effective management and disinfection of liquid waste may be overlooked.

2. The effectiveness of infection prevention responses in this area depends heavily on the implementation of strict policies, the availability of appropriate infrastructure, and a continuous commitment to training and monitoring. Therefore, the problem addressed by this study stems from the need for a genuine and objective assessment of the current response to infection prevention and control in the treatment of wastewater from medical laboratories.

3. Does the procedure followed whether formal policies or daily practices meet the required standards to ensure that risks are minimized.

1. To determine the existence and updating of written and approved policies for wastewater management and pre-disinfection in medical laboratories.

2. To measure the actual adherence to Standard Operating Procedures (SOPs) for disinfecting and separating wastewater from high-risk sample handling areas.

3. To assess the level of training and awareness among laboratory staff regarding safe procedures for handling and disposing of wastewater.

4. To evaluate the quality of the monitoring system, the documentation of treatment records, and the extent to which periodic microbiological testing of wastewater is conducted.

5. To explore the main obstacles and challenges faced by staff in implementing infection prevention standards for wastewater.

MATERIALS AND METHODS

This section aims to describe the methodological framework used in this study to collect and analyze data related to evaluating infection prevention and control (IPC) response in the management and disinfection of wastewater in medical laboratories.

Study Design:

This study adopted a descriptive analytical approach, using a cross-sectional survey. This design was chosen to collect data on the opinions, practices, and policies implemented in medical laboratories at a specific time, with the goal of assessing the current situation and wastewater management.

Study Population and Sample:

The study population comprises all medical laboratories (government and private) operating in Zliten city.

Study Sample:

A convenience or purpose sample of 13 laboratories was selected, privet, independent, and government laboratories.

Participants: The questionnaire targeted individuals directly responsible for implementing or supervising infection prevention and control policies and biological waste management within the laboratories. This included (as stated in the survey):

a) Laboratory managers or department heads.

b) Infection Prevention and Control (IPC) officers.

c) Technicians and specialists responsible for handling liquid waste.

Data Collection:

A self-designed questionnaire was used as the main data collection instrument, and it was built based on local and international guidelines relating to biosafety and laboratory wastewater management.

Ethical Considerations:

Written approval was obtained for the research from College, and privet laboratories in Zliten city. All participants were informed of the study's objectives and their right to withdraw at any time. Participation was emphasized as voluntary, and all collected data was to be treated with strict confidentiality and used solely for scientific research purposes, without disclosing the identity of any participants or laboratories.

Study related:

This study essentially proves that discharging laboratory waste into sewers is not just a germ problem, but an ecosystem disaster. While general hospital wastewater is difficult to treat, medical laboratory wastewater is far more toxic. It is so toxic that even at just 10% of the mix, it kills the beneficial bacteria (nitrifying bacteria) that purify our water. Analysis: Laboratory waste is toxic: At 10%, laboratory waste killed 72% of the purifying bacteria in standard systems, while general hospital waste killed only 39%. Beneficial bacteria die: The bacteria responsible for removing nitrogen (nitrifying bacteria) are extremely sensitive. When they die, the entire treatment plant stops working, resulting in contaminated water leaking into the environment. Comparison of Membrane Bioreactor (MBR) and Conventional Systems: The study found that MBRs which are advanced filters handle toxic shocks better than conventional activated sludge systems. This is because MBRs cultivate a more diverse and robust bacterial community.

What does this mean for us?

We can't simply treat laboratory waste like regular sewage. If a laboratory doesn't pre-treat its wastewater before it enters the public sewer system, it could cause a complete biological meltdown at the treatment plant. The goal of any laboratory should be to separate and neutralize

chemicals on-site so that we never reach the "10% danger zone," where the cleaning bacteria begin to die.

***Statistical Analysis*:**

The results showed a sharp disparity in compliance levels as follows:

Structural Compliance (100% Yes): Participants agreed that there is regular inspection and maintenance of the sewer system to detect leaks.

Procedural and Policy Compliance (0% Yes): Participants agreed that there are no written policies, no classification of wastewater, and no pre-treatment with chemicals.

Awareness and Training (0% Yes): There is a complete absence of annual training, informational posters, and periodic meetings to discuss exposure incidents.

Overall Assessment: All participants (100%) rated the effectiveness of the current response as "very weak."

***Sample Size*:**

The Statistics table shows that the number of participants is 150 (Valid = 150). Missing Values: 0 in all columns, which is an excellent indicator, meaning that all participants answered all questions and there are no missing data.

***Participant Profile (Job Title)*:**

The Frequency Table shows the distribution of job titles as follows: Specialists: Represent the vast majority at 97.3% (146 participants). Heads of Departments (HOD): Represent a very small percentage at 2.7% (only 4 participants). Analytical Note: Since most of the sample consists of "Specialists," the results primarily reflect the perspective of the operational and technical staff who work directly with the laboratory, and not necessarily the perspective of senior management.

***Standard Deviation Analysis*:**

An interesting point in the table above concerns the standard deviation values: Complete Consensus: For questions such as Existence of a written policy, Water classification, and Chemical disinfection, the standard deviation is 0.00000. All 150 participants agreed on the same answer, indicating a lack of written policies, training programs, and attention to wastewater discharged from medical laboratories, leading to an increased risk of infection transmission in the community. Variability in Responses: The highest variation is found in the question approximate estimate of daily wastewater discharge, where the standard deviation is 0.96537. This suggests that the discharged quantities, or their estimated amounts, vary from one laboratory to another

Table 1: The respondent of job title

The respondent›s job title is					
		Frequency	Percent	Valid Percent	Cumulative Percent
Valid	HOD	4	2.7	2.7	2.7
	Specialist	146	97.3	97.3	100.0
	Total	150	100.0	100.0	

The data indicates that the sample consists almost entirely of specialists. This means that the survey indicators focus on real-world laboratory collaboration, with 146 participants, or 97.3%.

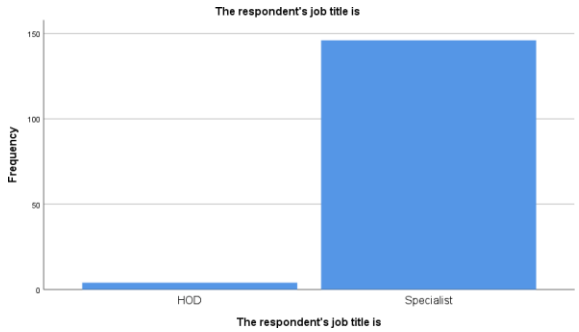


Figure 1: The respondent of job title

Table 2: Laboratory type

Laboratory type :					
		Frequency	Percent	Valid Percent	Cumulative Percent
Valid	Gov	94	62.7	62.7	62.7
	Private	27	18.0	18.0	80.7
	Independent	29	19.3	19.3	100.0
	Total	150	100.0	100.0	

The data shows that the study focuses primarily on government, and it was 62.7% of the sample.

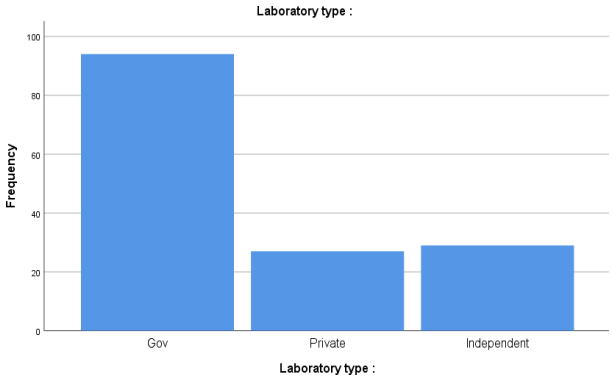


Figure 2: Laboratory type

Table 3: Amount of water discharged from the laboratory daily

Approximate estimate of the amount of water discharged from the laboratory daily?					
		Frequency	Percent	Valid Percent	Cumulative Percent
Valid	Less than 50 letter	55	36.7	36.7	36.7
	50-200 letter	1	.7	.7	37.3
	More than 200 letter	94	62.7	62.7	100.0
	Total	150	100.0	100.0	

This table is crucial for understanding the scale of the environmental impact of laboratories: More than 200 liters: This is the largest category, with 94 participants (62.7%) reporting that their laboratories use more than 200 liters daily Less than 50 liters: This category comes in second with 55 participants (36.7%). Between 50 and 200 liters: This category is very rare in the study sample, with only one participant (0.7%) selecting it.

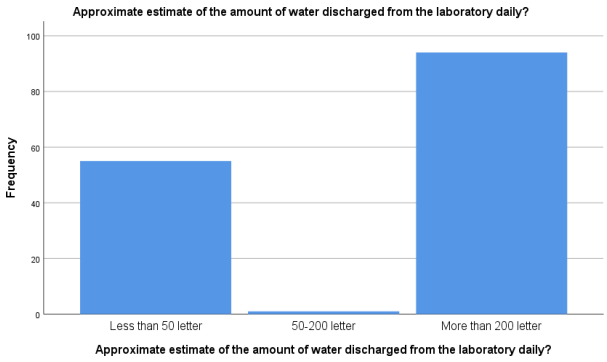


Figure 3: Amount of water discharged from the laboratory daily

DISCUSION

The study's central problem revolves around a serious operational gap. While laboratories adhere to the engineering aspect (network maintenance 100%), they completely lack specialized preventative measures (disinfection and policies 0%). The dimensions of this discussion can be summarized as follows. The illusion of structural integrity: Maintaining networks without chemical disinfection means the laboratory is effectively transferring contamination to the outside, rather than eliminating it, thus transforming wastewater into a silent environmental hazard. The absence of administrative oversight: The lack of written policies (0%) has marginalized the issue of wastewater, resulting in a very weak response, according to staff consensus, due to the absence of binding guidelines. Knowledge stagnation: The lack of annual training (0%) prevents staff from keeping up with water classification and treatment standards, limiting the specialist's role to conducting tests without addressing the resulting contaminated outputs. The public health risk: The participants' unanimous agreement (100%) on the weak response raises serious concerns about the potential leakage of chemical and biological pollutants into the surrounding environment, threatening occupational and public safety. In short: the problem isn't "pipe failure, but rather the absence of a protocol. The real challenge lies in transforming wastewater management from a mechanical drainage process to a comprehensive, biological treatment process.

CONCLUSION

The study concludes that the infection prevention system in wastewater management requires a complete overhaul. Simply ensuring pipe integrity and preventing leaks is insufficient; chemical disinfection protocols must be enforced at the source, personnel must receive intensive training, and clear policy guidelines and signage must be provided in the workplace. Moving from structural maintenance to comprehensive biological treatment is the only way to guarantee that medical laboratories do not become a silent source of environmental pollution and health hazards.

RECOMMENDATIONS

1. Adopt a unified and binding policy for wastewater management and treatment.

2. Mandate that laboratories perform initial chemical disinfection before discharging into the public network.

3. Implement mandatory annual training programs and include wastewater treatment in external audit programs.

REFERENCES

1. Bandh SA, Mushtaq B. (2025) Wastewater Treatment Technology: Technical Progressions and Advances. Springer; Pages 1-65

2. Ansari MAS, Islam MJ, Jany MR, Nargis F, Hossain MN, Hosen MM, *et al*. (2024) Wastewater Treatment and Reuse: Preventive Measures for Chronic Infectious Diseases, *Integr Biomed Res.* **8**(12), 1–12.

3. Olorunsogo TO, Ogugua JO, Muonde M, Maduka CP and Omotayo O. (2024) Environmental factors in public health: A review of global challenges and solutions, *World J Adv Res Rev*. **21**(1), 1453–1466.

4. El-Gamasy SM, Mubark AE, Razek SEA and Eliwa AA. (2025) A study on the adequacy of some actinides adsorption on a modified guanidine Schiff base from laboratory effluents, *Can J Chem Eng*. **103**(6), 2864–2879.

5. Haelewaters D, Hughes M, Barão-Nóbrega JAL, Slater K and Martin TE. (2024) Standard deviation: Standardized bat monitoring techniques work better in some ecosystems, *PLoS One* **19**(12), e0311553.

6. Rai MSK. (2024) Principles and practices in water and wastewater engineering. Academic Guru Publishing House. PAGE 320

7. Partal, R., Murat Hocaoglu, S., and Yigit, N. Ö. (2024) Acute inhibition of hospital and medical laboratory wastewater on activated sludge, *Environmental Technology* **45**(2), 262-271.